CITY OF EDMONDS
BLDG. DEPT.
CONDITIONAL PERMIT

WORK- EXHAUST SYSTEM
ADDRESS- 22814 100th AVE W
OWNER- North China Restaurant
APPROVED DATE- 2-20-86
BY H. Reeves
BLDG. OFFICIAL

KEEP THESE STAMPED PLANS ON JOBSITE FOR ALL INSPECTIONS

PERMIT NO. 860119 | SHEET ___ OF

FEB 6 REC'D

CITY COPY

CODE 1982 UMC

BOX 18

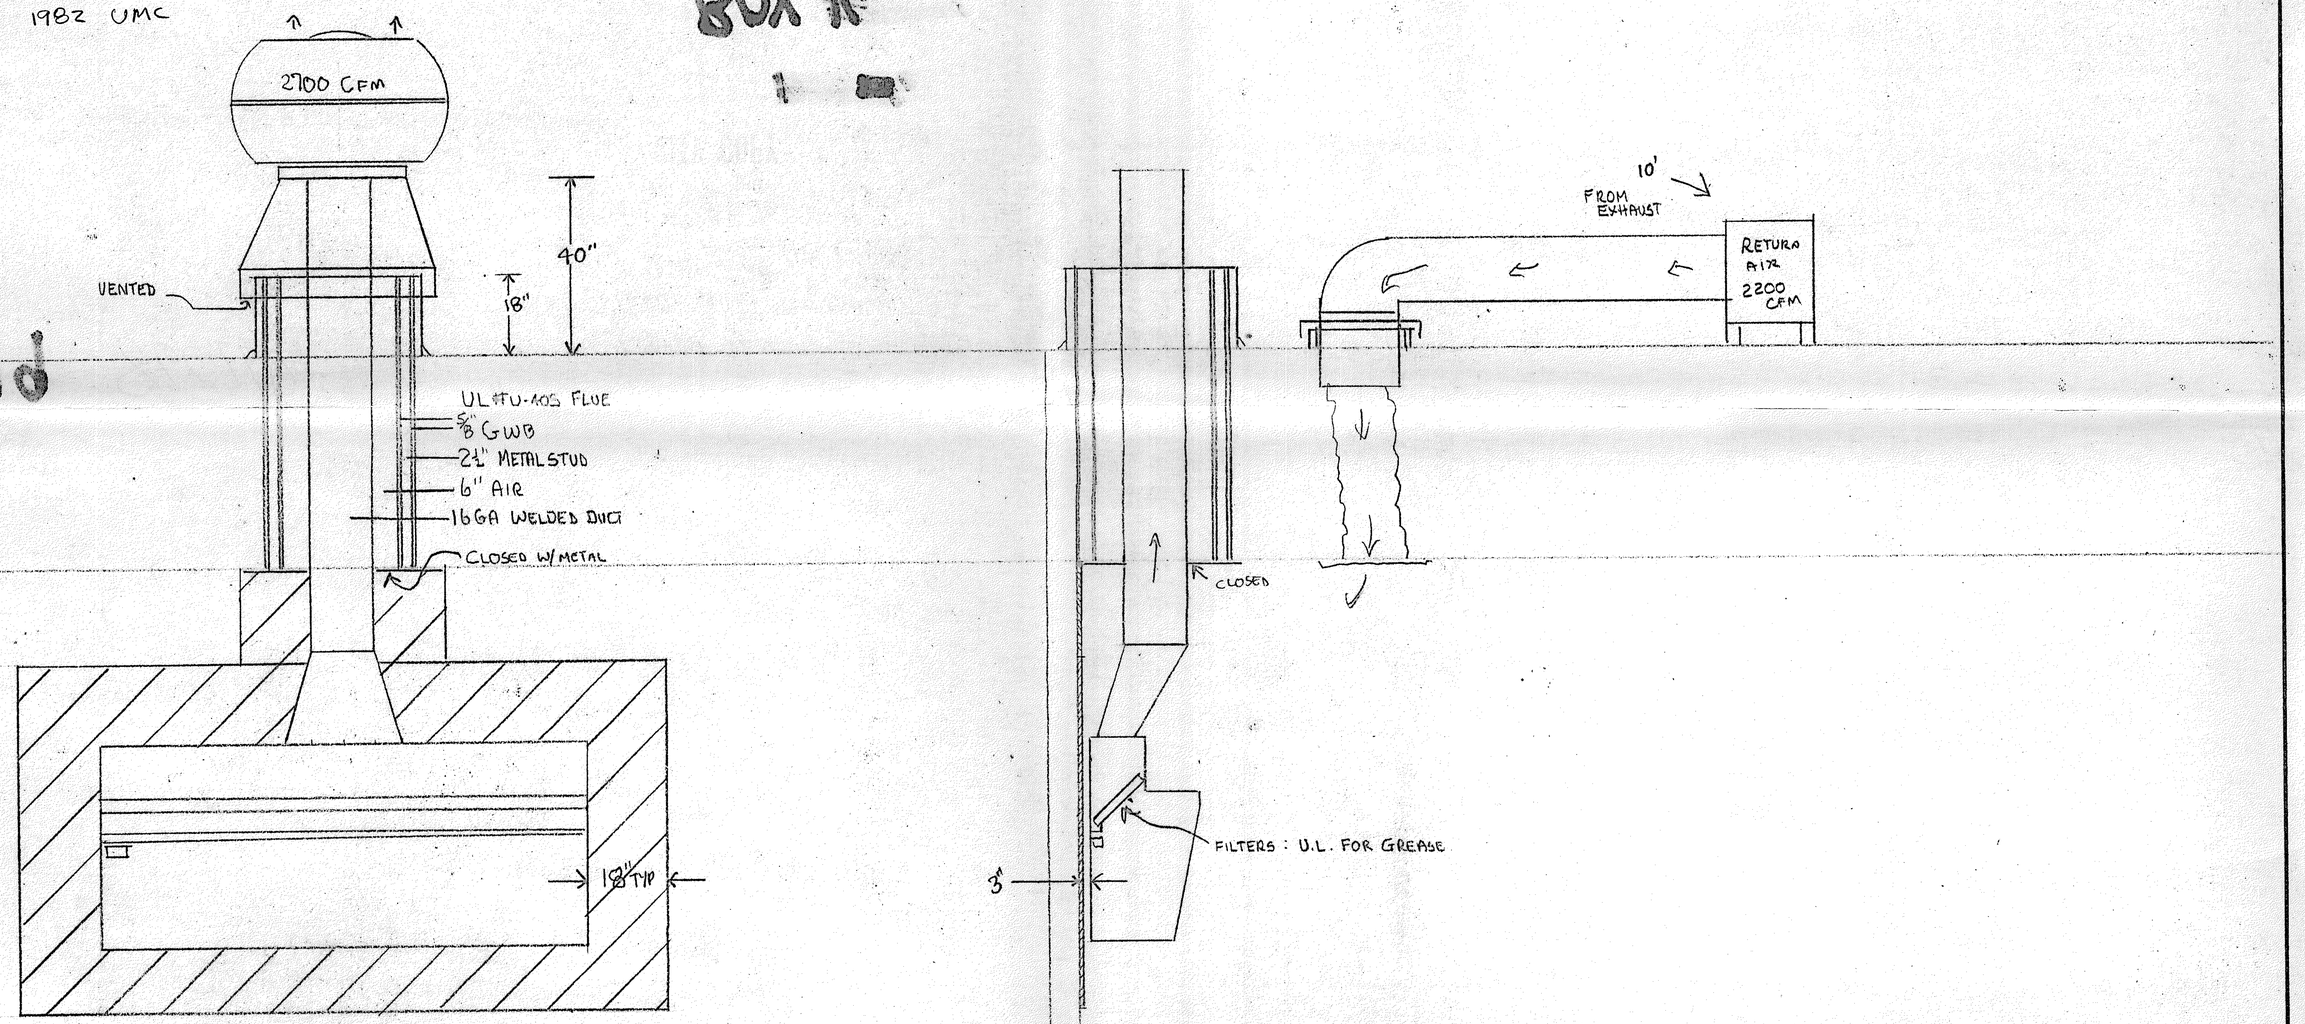

HOOD: TYPE I NON-CANOPY 9' x 300 = 2700 CFM
DUCT: 14½" x 14½" 16GA WELDED STEEL 1850 FPM VELOCITY
▨ : 22 GA. STEEL ON 1" MINERAL WOOL
EXHAUST FAN: 2800 CFM @ ⅝" S.P.
RETURN AIR: 80% 2200 CFM ON COMMON SWITCH W/ EXHAUST
FLUE: U.L. #U-405 6" AIR
FIRE SUPPRESSION : BY OTHERS

ERICKSON MFG & EQPT.
5532-208TH S.W.
LYNNWOOD 98036
775-3597
ER-IC-K1*212L7

NORTH CHINA RESTAURANT
22814-100TH AVE. W.
EDMONDS

SCALE: ½" = 1'	APPROVED BY:	DRAWN BY
DATE: 2-3-86		REVISED
		DRAWING NUMBER

18 X 24 PRINTED ON NO. 1000H CLEARPRINT